



M44 Series
440 kA Per Phase
Peak Surge Current
ANSI/UL1449 UL Fourth Edition
Type 1 SPD (no filter), I_n = 20 kA
Type 2 SPD (filter), I_n = 20 kA

Designed specifically for the new construction and “bid spec” market place, the M44 series of Surge Protective Devices provides the features, performance and value required by discriminating specifying engineers. This device is intended for protection of general-purpose load applications ranging from individual equipment disconnects and sub panels to distribution panels and service entrance locations. It is extremely effective in limiting lightning surges as well as internally generated transients.

The M44 series provides an effective blend of leading-edge suppression design technology, straight forward, no frills engineering and customer driven, value added options. Specify PANELGUARD with confidence.

- Description:** Parallel connected, AC power Surge Protective Device.
- Application:** Designed for use at ANSI/IEEE C62.41.1 & C62.41.2 location categories C, B and A. Designed to protect all types of loads fed from individual disconnects, sub panels, distribution panels and service entrance locations.
- Warranty:** 15 Years
- Unit Listings:** *Listed to ANSI/UL 1449 by UL (E315947), CSA (MC#241804); UL1283* (* Type 2 SPDs only)*
- Circuit Design:** Parallel connected, hybrid circuit design incorporating both component level thermal fusing and internal over-current fusing. All protection circuits are encapsulated in our high dielectric compound to promote long component life and protection from the weather and vibration.
- Directly Connected Protection Modes:** All Mode – L-L, Discrete L-N (Normal Mode), and Discrete L-G, N-G (Common Mode).
- Input Frequency:** 50-420 Hz (60 Hz typical)
- Insertion Loss Data: (L-N for 3Y1)**

| Frequency: | 280 kHz | 1 MHz | Max Attenuation & Freq. |
|--------------|---------|-------|-------------------------|
| Attenuation: | 3 dB | 17 dB | 40 dB @ 483 kHz |
- EMI/RFI Filtering:** Up to 41 db normal mode, 39 db common mode
- Circuit Diagnostics:** Super Bright LED, 1 per phase, normally on. See pg. 2 for additional diagnostics options
- Connection/mounting:** #10 Wire (pre-installed), hub (installed at time of installation) and integral, multi-point mounting feet.
- Circuit Interrupt:** Internal component-level, thermal fusing and patented circuit board mounted, over-current fusing. No external over-current protection required. (Note: National and local codes may require the use of a circuit interrupt device(s) if conduit is added to make the wired connection to the panel or gear.) SCCR = 200 kA
- Nominal Discharge Current (I_n) Rating:** 20 kA** (** Complies with the requirements of UL 96A Master Label for Installation Requirements for Lightning Protection Systems)




Key Features:

- Industry Leading Measured Limiting Voltage Performance
- Independent Verification of Performance and Safety
- Component-Level, Thermal Fusing and Over-Current Fusing
- No moving parts or springs - No mechanical or electro-mechanical thermal/over-current protection
- Circuit Encapsulation

| Voltage Code | ANSI/UL 1449 (Fourth Edition) Voltage Protection Rating (VPR) | | | | | | |
|--------------|---|------|------|------|-----|------|------|
| | L-N | HL-N | L-G | HL-G | N-G | L-L | HL-L |
| 1P1 | 600 | - | 600 | - | 600 | - | - |
| 1S1 | 600 | - | 600 | - | 600 | 1200 | - |
| 3Y1 | 600 | - | 600 | - | 600 | 1200 | - |
| 3D1 | 600 | 900 | 600 | 1000 | 600 | 1200 | 1800 |
| 3Y2 | 900 | - | 1000 | - | 900 | 2000 | - |
| 3N4 | - | - | 1800 | - | - | 1800 | - |



| Options | Description |
|----------------------|---|
| DG1 | LED Indicators |
| DG2 ⁽¹⁾ | Basic Internal Audible Alarm |
| DG3 ⁽¹⁾ | Basic Alarm/ Surge Counter |
| DG4 ⁽¹⁾ | Advanced Alarm w/ surge counter on, off, and test |
| (1) | Form C Dry Relay Contacts (With DG2, DG3 & DG4 options) |
| D5 (CSA) | Integral Disconnect Switch ** |
| D6 (CSA) | Integral Disconnect Switch (no external handle) ** |
| -LPX | Remote LEDs in liquid tight holders |
| P | Flush Mount Plate |
| Standard Enclosure | NEMA 4X Composite Enclosure |
| 24 | 24" wire leads |
| 36 | 36" wire leads |
| 48 | 48" wire leads |
| 60 | 60" wire leads |
| Standard Wire Length | 18" wire leads |

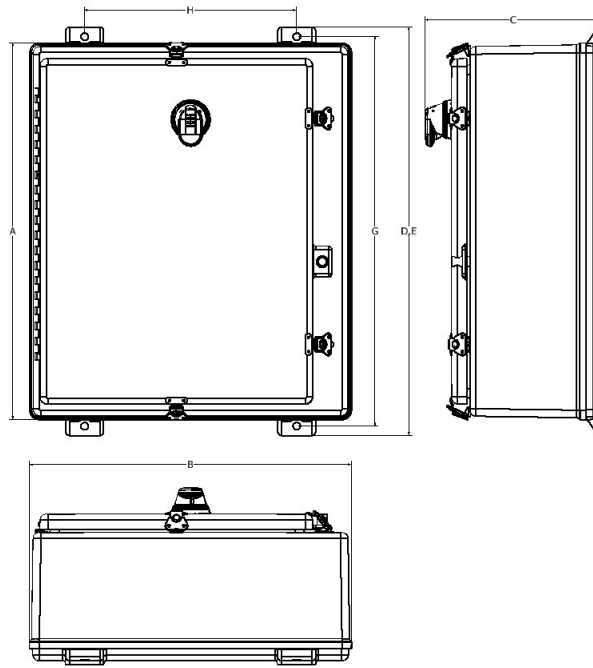

| Enclosure Dimensions | | |
|----------------------|-------------------|------------------------------|
| Inches (mm) | DG1-DG4 Option | DG1-4 Option |
| | No Disconnect | DG5 or DG6 Disconnect |
| A | 15.25 (387) | 24.89 (632) |
| B | 13.25 (337) | 21.25 (540) |
| C | 7.72 (196) | 10.24 ⁽¹⁾ (260) |
| D | 16.25 (413) | 27.00 (686) |
| E | 17.21 (437) | 27.00 (686) |
| G | 15.25 (387) | 25.75 (654) |
| H | 9.50 (241) | 14.00 (356) |
| Type | NEMA 4X Composite | |
| lbs. (kg) | 32.51 (14.75) | 55.47 ⁽²⁾ (25.15) |

⁽¹⁾ This dimension is 11.68 in. (297mm) when option D5, external disconnect, is selected.

⁽²⁾ The weight is 66.57 lbs. (30.20kg), when option D5 or D6 is selected.

Model Number Example: M44S23Y2DG3

| Base Model: | Modes of Protection: | Advanced Filtering: | Voltage Codes: | Options: |
|--------------|----------------------|-------------------------|--------------------------|-------------------------|
| M44 = 440 kA | S = Seven | 1=No Filter 2=Filter | See Voltage Codes 3Y2 | See Option codes DG3 |

MEASURED LIMITING VOLTAGE PERFORMANCE AND ELECTRICAL SPECIFICATIONS

| Voltage Code* | Circuit Type | Peak Surge Current (Amps) Per Mode & Per Phase | MCOV | ANSI/IEEE C62.41.1 TM -2002, C62.41.2 TM -2002, C62.45 TM -2002, and C62.62 TM -2010 Measured Limiting Voltages (tested with 6 inches of lead length external to the enclosure per Clauses 6.1.1 of C62.62 TM -2010 and 37.4.4 of ANSI/UL 1449-2006) | | |
|---------------|--------------------------------------|--|------|---|---|---|
| | | | | Test Mode | Cat A 30 Ω 100 kHz Ring Wave 6 kV 200 A @ 90° Phase Angle | Category C (High) 10 kA 8/20 Current Driven Test [†] |
| 1P1 | 120 V, Single Ø (2 wire + ground) | 220,000 Per Mode (L-N, L-G, N-G) 440,000 Per Phase | 150 | L-N | 261 V | 729 V |
| | | | | L-G | 272 V | 781 V |
| | | | | N-G | 491 V | 991 V |
| 1S1 | 120/240 V, Split Ø (3 wire + ground) | 220,000 Per Mode (L-L, L-N, L-G, N-G) 440,000 Per Phase | 320 | L-L | 412 V | 964 V |
| | | | | L-N | 261 V | 729 V |
| | | | | L-G | 272 V | 781 V |
| 3Y1 | 120/208 V, 3ØY (4 wire + ground) | 220,000 Per Mode (L-L, L-N, L-G, N-G) 440,000 Per Phase | 150 | L-L | 412 V | 964 V |
| | | | | L-N | 261 V | 729 V |
| | | | | L-G | 272 V | 781 V |
| 3D1 | 120/240 V, 3ØΔ (4 wire + ground) | 220,000 Per Mode (L-L, L-N, HL-N, L-G, HL-G, N-G) 440,000 Per Phase | 320 | L-L | 412 V | 964 V |
| | | | | L-N | 261 V | 729 V |
| | | | | HL-N | 392 V | 1,374 V |
| 3Y2 | 277/480 V, 3ØY (4 wire + ground) | 220,000 Per Mode (L-L, L-N, L-G, N-G) 440,000 Per Phase | 320 | L-L | 484 V | 1,758 V |
| | | | | L-N | 392 V | 1,374 V |
| | | | | L-G | 376 V | 1,414 V |
| 3N2 | 240 V, 3ØΔ (3 wire + ground) | 220,000 Per Mode (L-L, L-G) 440,000 Per Phase | 320 | L-L | 412 V | 964 V |
| | | | | L-G | 376 V | 1,414 V |
| | | | | L-L | 412 V | 964 V |
| 3N4 | 480 V, 3ØΔ (3 wire + ground) | 220,000 Per Mode (L-L, L-G) 440,000 Per Phase | 550 | L-L | 505 V | 1,758 V |
| | | | | L-G | 505 V | 2,071 V |

Measured Limiting Voltage (MLV) Test Parameters: Positive polarity, Category A: Line power applied, Category C: No line power applied, Voltages are peak (±10%). Measured Limiting Voltages are measured from the insertion point on the sine wave to the peak of the surge for powered tests. Each phase is the average of the modes within that mode of protection. In order to duplicate the results, the specified mode of protection must be tested in all modes (except N-G) and averaged together. (Individual mode or shot results may vary by more than 10%. Scope Settings: Time Base = 10 microseconds per division, Sampling Rate = 2.5 Gigasamples/sec, Bandwidth = 400 MHz (200 MHz for Cat C), Probes: Tektronix P5100/P6015A. These settings help to assure MLV results are accurate). **All tests performed with 6" lead length (external to the enclosure), simulating actual installed performance.** The MLVs reported above are certified by Third-Party, Independent Testing. Individual test reports are available upon request.

[†]The MLV reported for the Category C High, 10 kA 8/20 Current Driven Test is determined by measuring the MLV of one of the fifteen 10 kA impulses impressed through the SPD during the Nominal Discharge Current (In) Test from C62.62TM-2010 and ANSI/UL 1449. This is not the MLV recorded during the pre- and/or post-test 6 kV / 3 kA Combination Wave Test used to determine the VPR of the SPD. The VPRs are reported on page 1 of this specification.

*Other voltage configurations may be available. Contact your sales representative for additional assistance.